




Vanguard Laboratory
2635 Parkmont Ln
Olympia, Wa 98502
360-967-7010

Certificate of Analysis

Tirzepatide 10 mg

Report To:
BioStem Labs

Compound: Tirzepatide
Quantity: 10 mg
Laboratory ID: V550904-14 001
Lot Number: SG0001
Date Reported: 04/17/2026

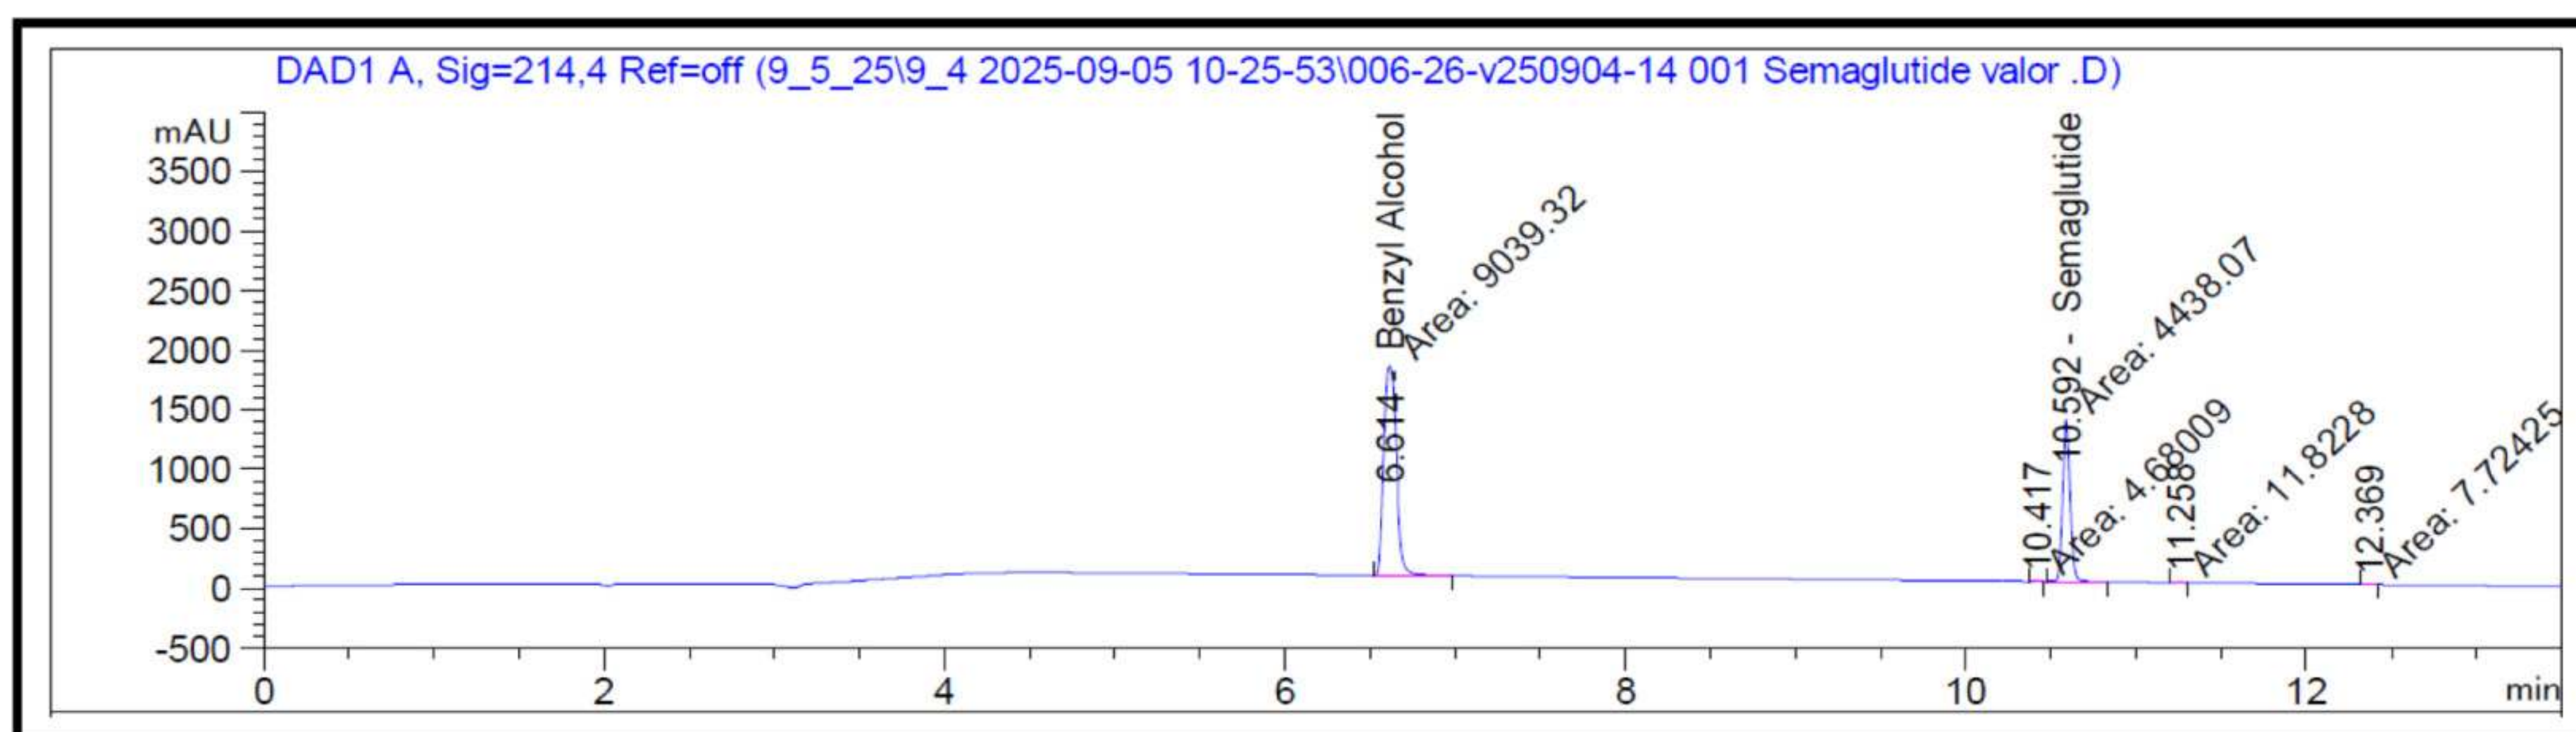

Analysis	Method	Result
Chromatographic Purity	HPLC-UV/VIS	99.46% ± 0.18%
Quantity	HPLC-UV/VIS	10.00 mg
Sterility	USP <61>	Pass
Endotoxins	LAL	<0.05 EU/mg



Report By: Dustin Newman, Laboratory Director on 04/17/2026

Approved By: Tori Johnson, Operations Manager on 04/17/2026



Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch.